


NOTES

- THIS DRAWING IS TO BE READ WITH ALL RELEVANT KENNEDY REDFORD DRAWINGS.
- PROPOSED PIPEWORK WITH LESS THAN THE FOLLOWING DEPTHS TO SOFFIT REQUIRES A CONCRETE SURROUND:
 - 1.2m IN ROADS
 - 0.6m UNDER FOOTPATHS AND UNDER BUILDINGS.
- MANHOLE COVERS AND FRAMES SHALL BE TO BS EN 124 AND SHALL BE KITEMARKED. COVERS AND FRAMES SHALL BE HEAVY DUTY E600 IN THE YARD AREA, HEAVY DUTY D400 IN THE CAR PARK AREA AND MEDIUM DUTY B125 IN FOOTWAYS AND SOFT LANDSCAPING.
- COVER LEVELS ARE TO BE ADJUSTED LOCALLY TO SUIT FINISHED GROUND LEVELS.
- MANHOLE COVERS AND FRAMES SHALL COMPLY WITH THE RELEVANT PROVISIONS OF BS EN124. HAVE MINIMUM 600 X 600 CLEAR OPENINGS WITH 150 DEEP FRAMES UNLESS OTHERWISE SPECIFIED.

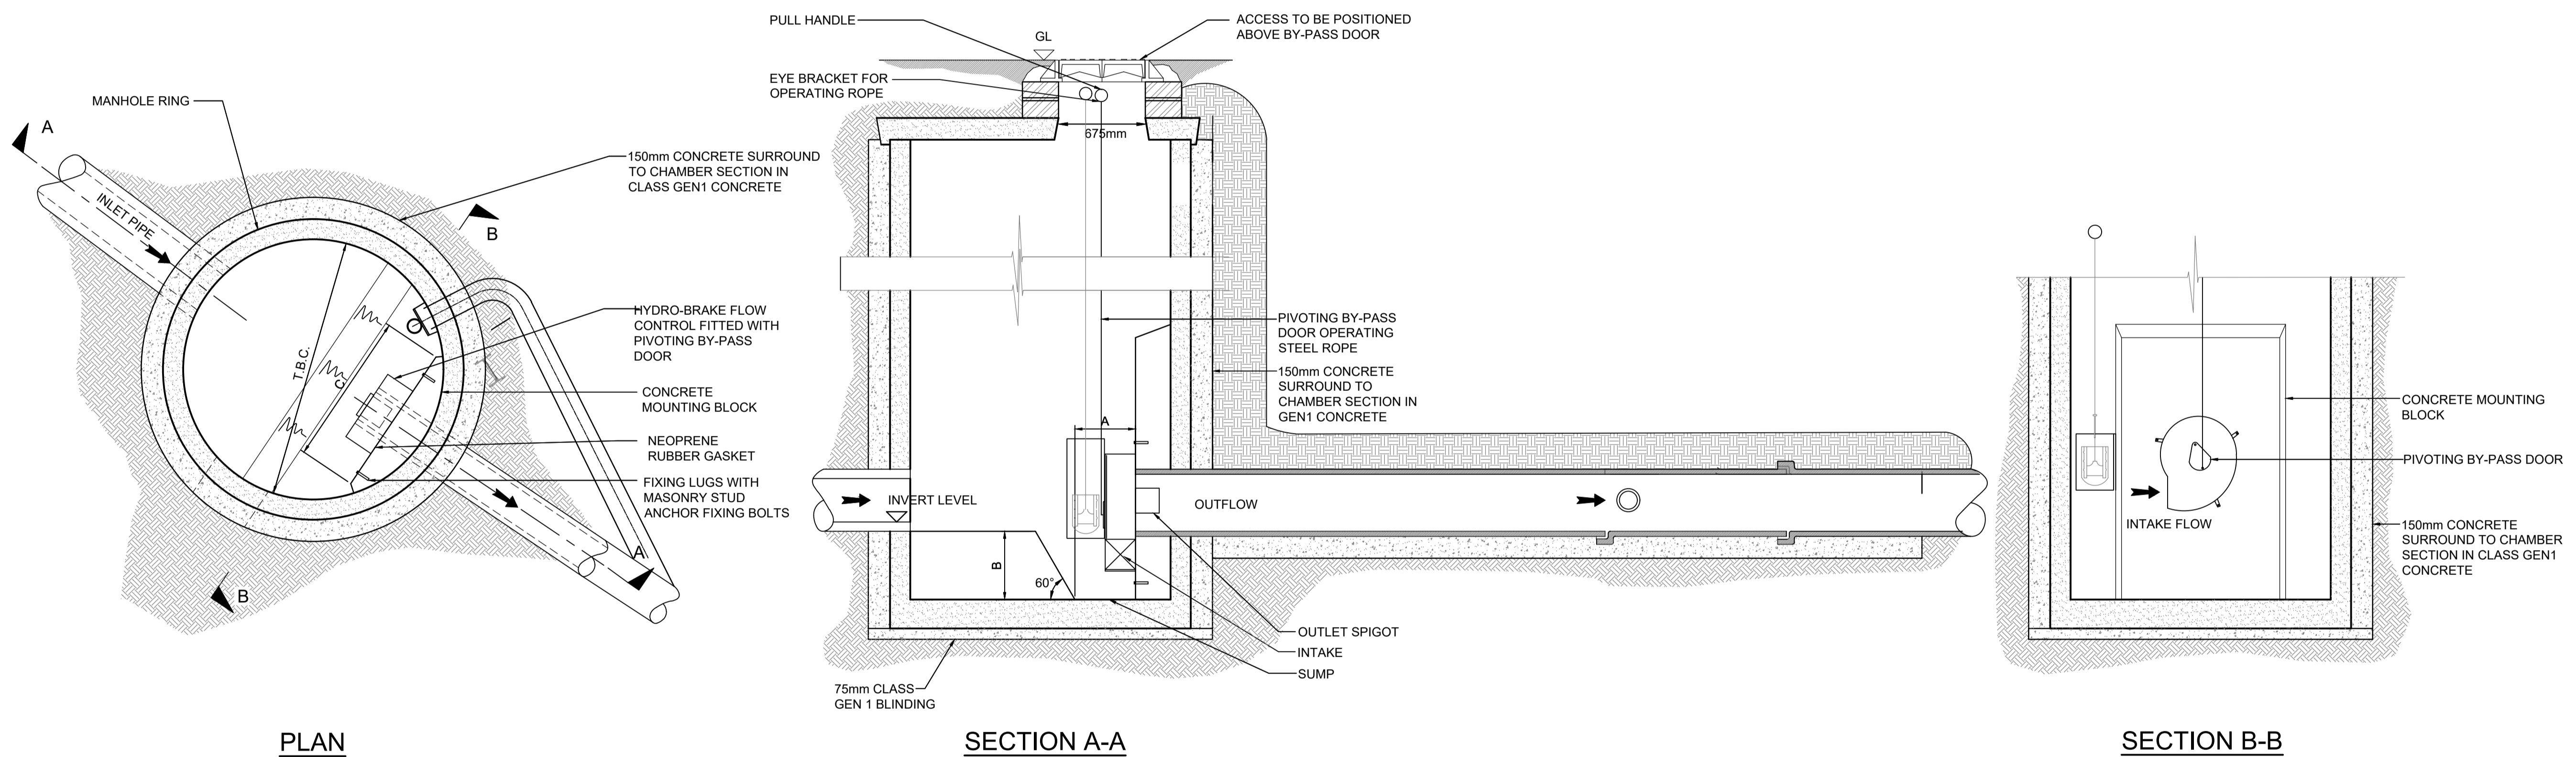

TYPICAL HYDRO-BRAKE DETAIL
SCALE 1:25

P01	14.06.22	PRELIMINARY ISSUE	R.B	R.K	R.K
REV	DATE	DESCRIPTION	DRN	CHK	APR
© This drawing is the property of Kennedy Redford Limited and the information can only be reproduced with their prior permission.					
Kennedy Redford MANAGING VISION					
CLIENT GWYNEDD SKIP & PLANT HIRE					
PROJECT NAME GWYNEDD SKIP & PLANT HIRE					
DRAWING TITLE TYPICAL FLOW CONTROL DETAIL ABATTOIR SITE					
DATE	SCALE	SHEET SIZE	REV		
14.06.22	1:10	A1	P01		
DRAWING STATUS S2 - ISSUED FOR INFORMATION					
DRAWING NUMBER 220208 - KR - XX - EX - DR - C - 0021					